


MEDIUM VOLTAGE "R" RATED  
 AMP-TRAP FUSE  
 TOTAL CLEARING TIME CURRENT DATA  
 2400/4800V (5.5KV MAX)  
 CAT. NO. A051B1DARO-(2R-12R)  
 A051B2DARO-(18R-24R)



Newburyport, MA 01950  
 102653

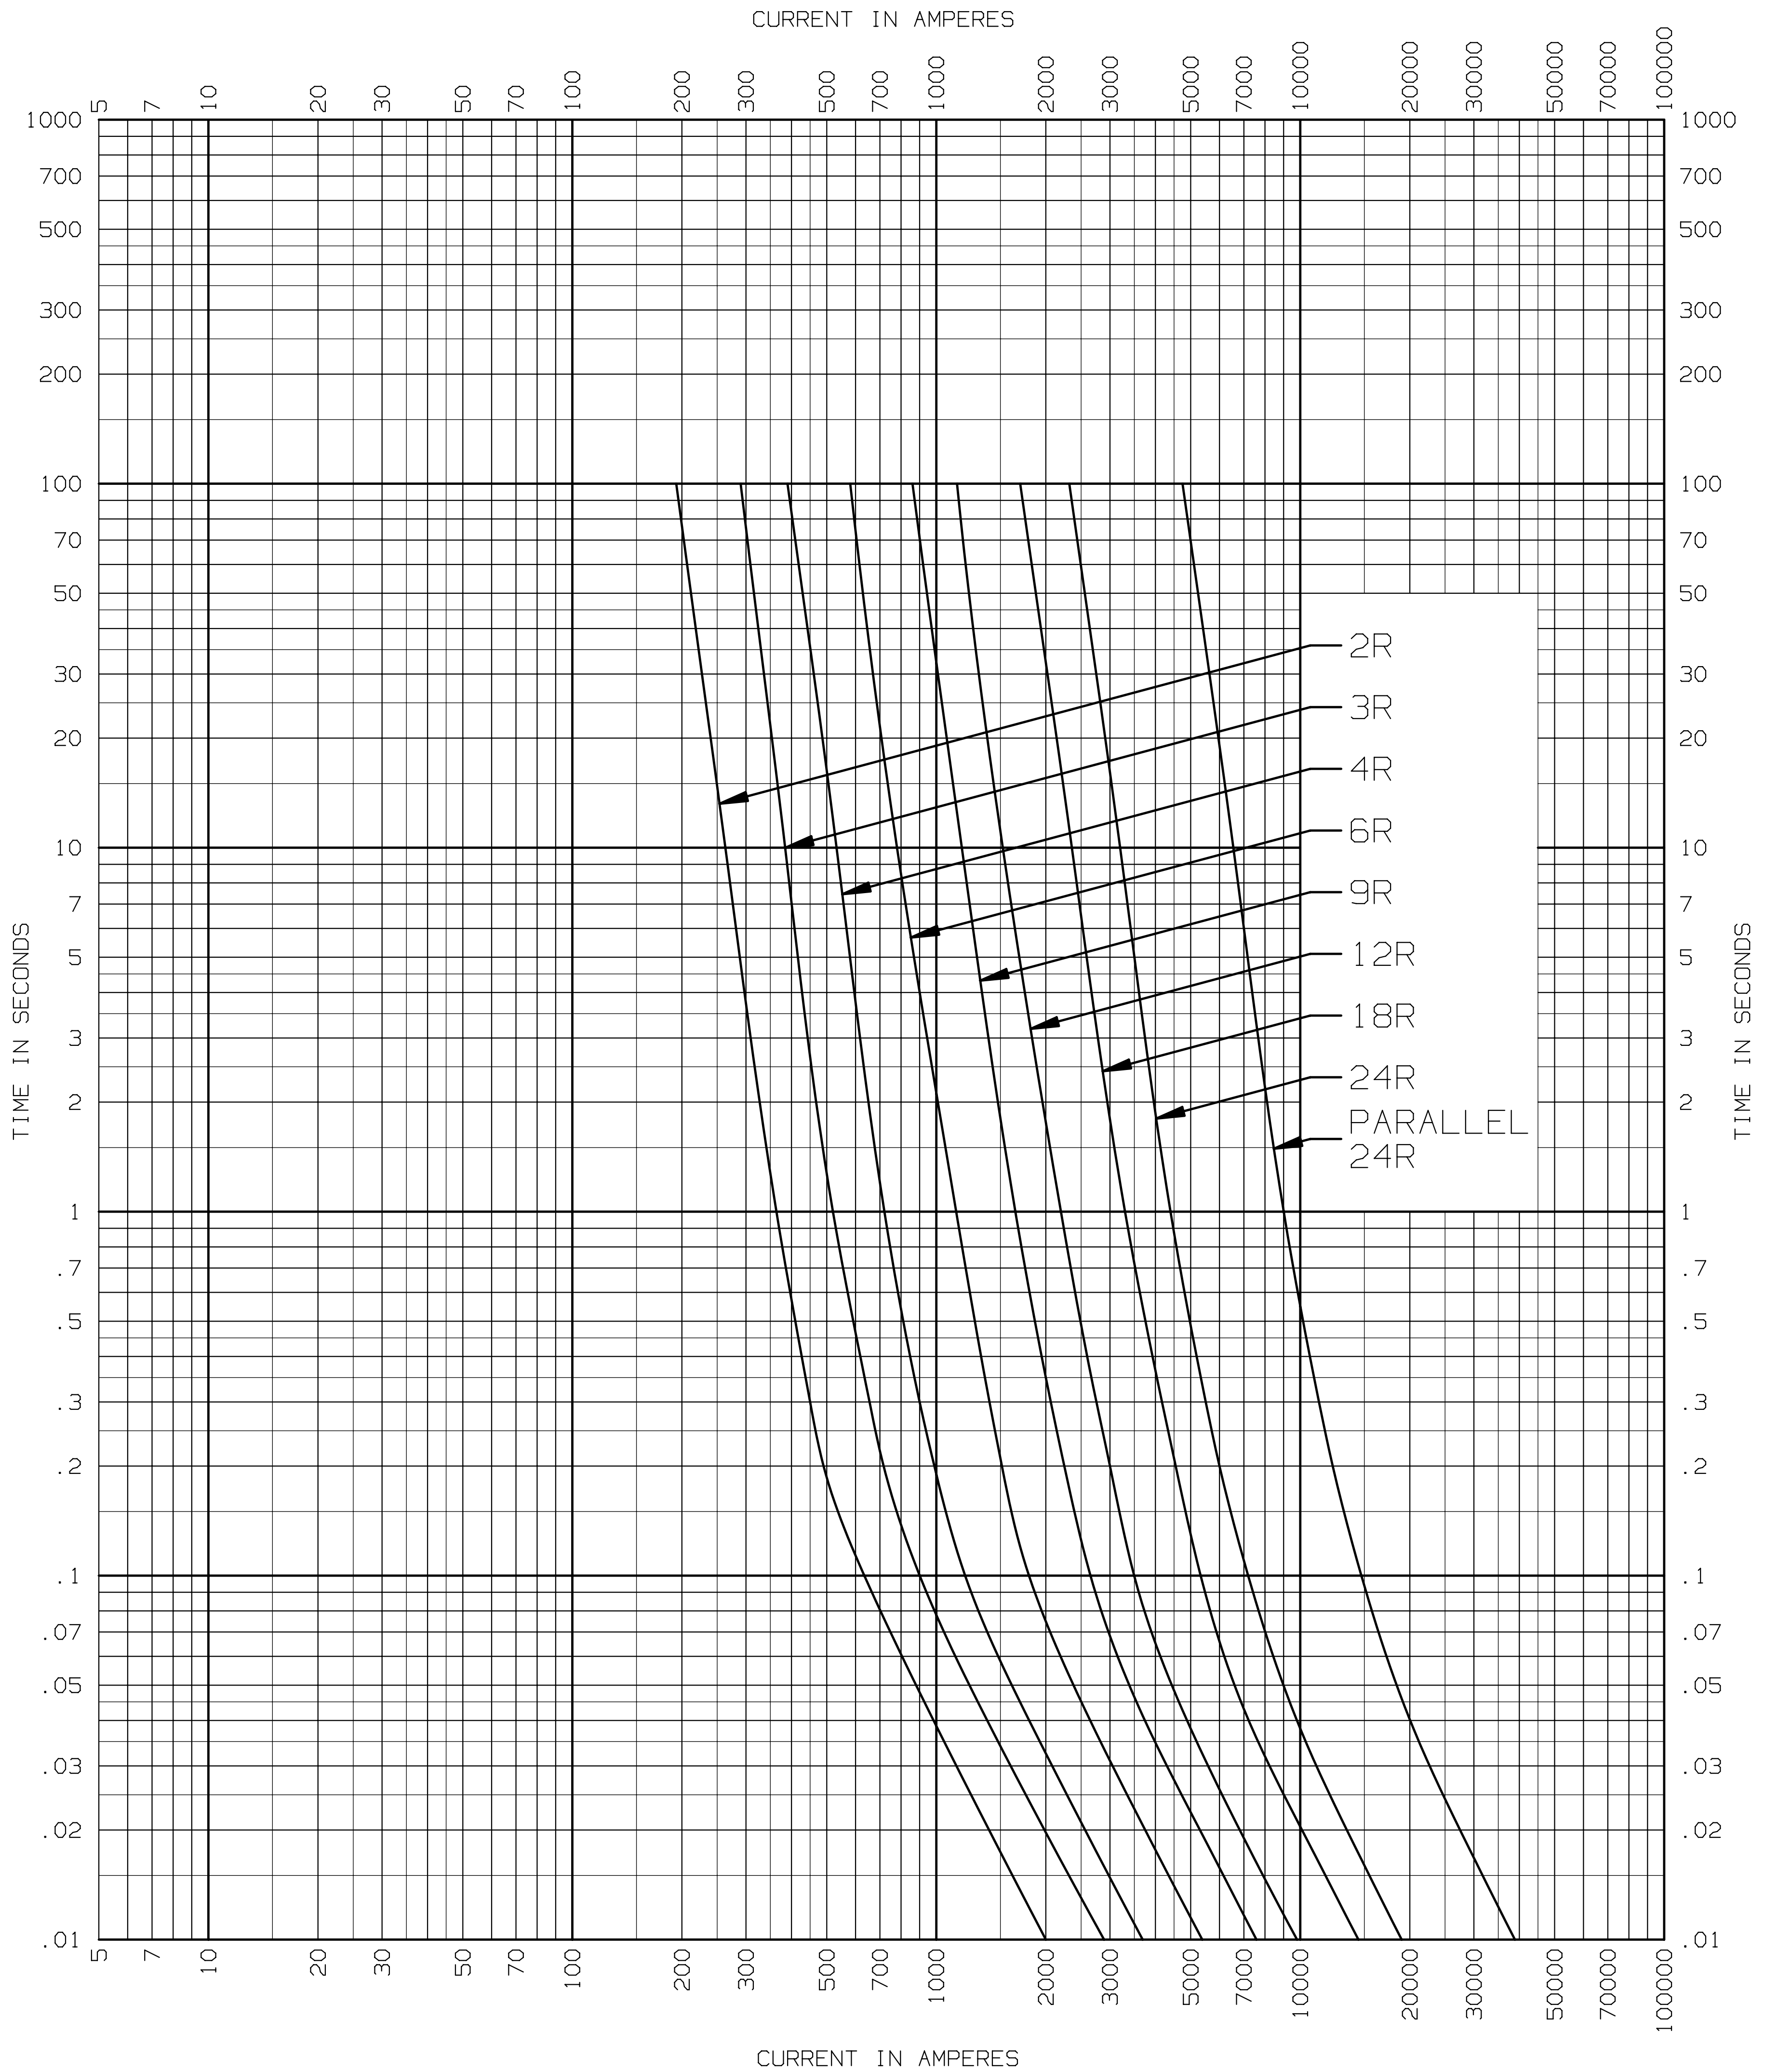

CONTROL NO: 731  
 FOLDER NO. 5B  
 REV. A  
 2/10/05